


Basement/groundwater separation procedure for Hochheim and Theresa soils

7/28/2014

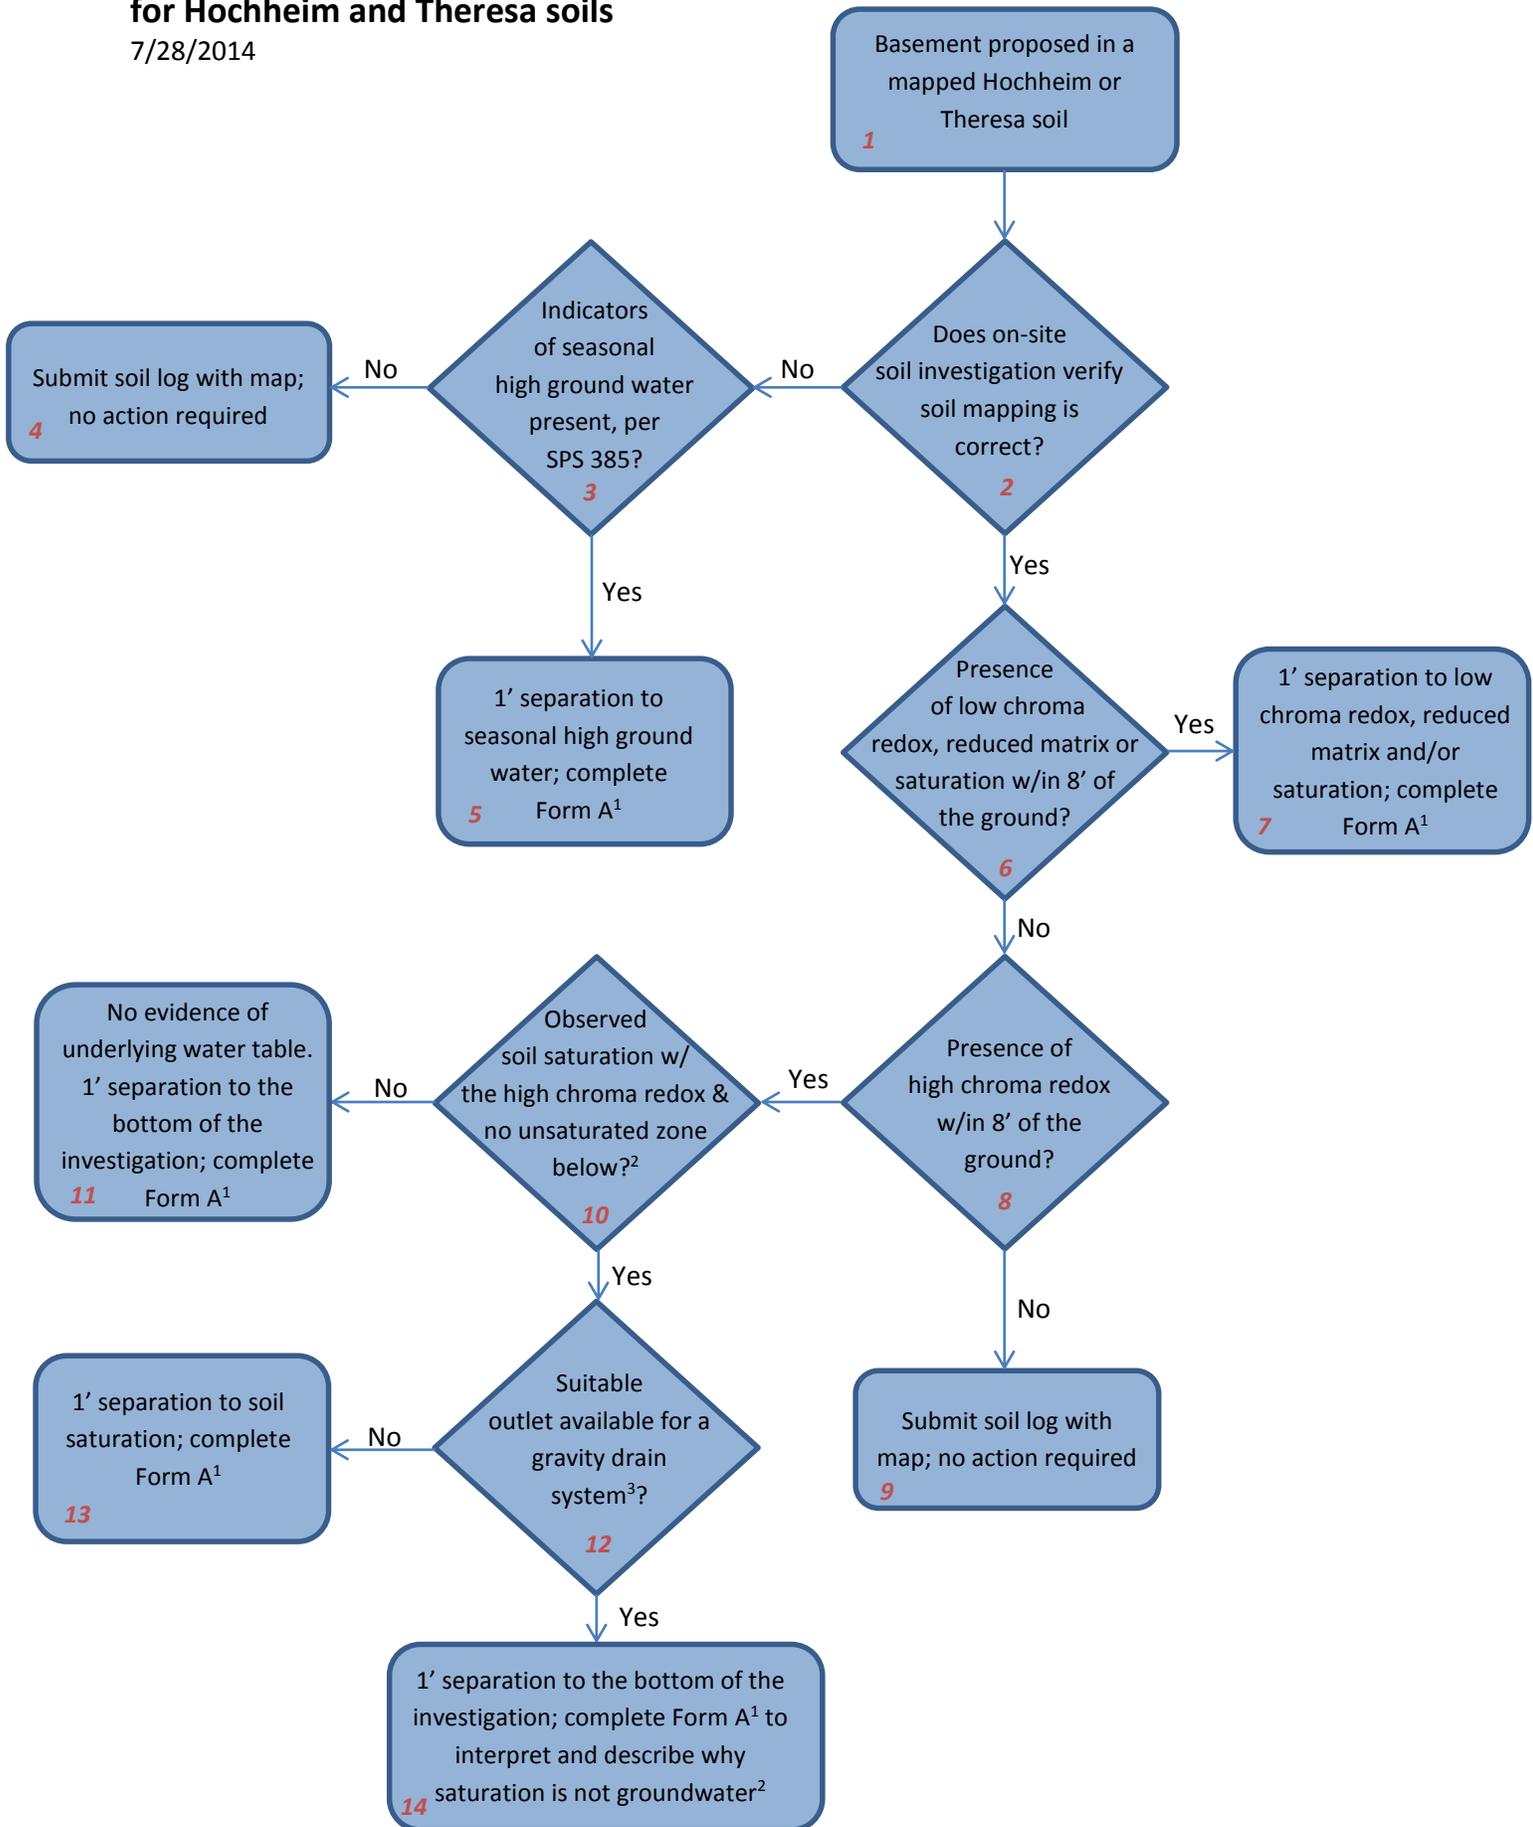

¹Form A is the seasonal high groundwater determination report which can also serve as an interpretative determination per SPS 385.60.

²The County may require soil investigations be completed to demonstrate saturated conditions do not exist at other times of the year.

³Plans must meet County standards; including design, construction verification and recording as-builts and maintenance plan.